



ସରକାରୀ ସ୍ୱୟଂଶାସିତ ମହାବିଦ୍ୟାଳୟ, ରାଉରକେଲା  
GOVERNMENT AUTONOMOUS COLLEGE, ROURKELA  
Sundargarh, Raghunathpali, Rourkela, Odisha



GOVERNMENT AUTONOMOUS COLLEGE

# ENERGY AUDIT REPORT

2021-2022

PREPARED BY  
EHS ALLIANCE SERVICES

# CONTENTS

AUDIT CERTIFICATE	2
ACKNOWLEDGEMENT	3
DISCLAIMER	4
ABBREVIATION	5
INTRODUCTION OF COLLEGE	6
AUDIT PARTICIPANTS	8
EXECUTIVE SUMMARY	9
ENERGY AUDIT ANALYSIS	9
1. ENERGY CONSUMPTION	10
2. DIESEL CONSUMPTION	11
3. ANALYSIS OF DG SETS	12
4. AC SYSTEMS	13
5. CEILING FANS ANALYSIS	16
6. ANALYSIS OF LIGHTING SYSTEM	17
6.1. BRIEF DESCRIPTION	17
6.2. INVENTORY OF LIGHTING	17
6.3. LUX MEASUREMENT	18
7. OTHER POWER CONSUMPTION	20
7.1 INVENTORY OF IT INFRASTRUCTURE	20
7.2 PUMP DETAILS	21
7.3 EXHAUST FAN DETAILS	22

# CERTIFICATE



## CERTIFICATE

PRESENTED TO

## GOVERNMENT AUTONOMOUS COLLEGE

Raghunathpali, Rourkela, Odisha 769004

Has been assessed by EHS Alliance Services for the comprehensive study of Energy Audit on institutional working framework to fulfill the requirement of

## ENERGY AUDIT

**ACADEMIC YEAR 2021-22**

The energy-saving initiatives carried out by the institution have been verified in the report submitted and were found to be satisfactory.

The efforts taken by management and faculty towards all types of energy used in the institution and sustainability are highly appreciated and noteworthy.

A handwritten signature in blue ink, appearing to be 'H. Das'.

SIGNATURE



15.09.2022

DATE OF AUDIT

EHS ALLIANCE SERVICES, PLOT A-72, SURYA VIHAR, GURUGRAM, 122001  
WWW.EHSALL.IN | BUSINESS@EHSALL.IN | EHSALLIANCE@GMAIL.COM

# ACKNOWLEDGEMENT

EHS Alliance Services would like to thank the management of Government Autonomous College for assigning this important work of Energy Audit. We appreciate the co-operation to the teams for completion of assessment.

We would also like to thank ***Dr. Pratap Kumar Swain (Asst. Professor - Department of Chemistry) – Audit Coordinator***, for his continuous support and guidance, without which the completion of the project would not have been possible. We are also thankful to other staff members who were actively involved while collecting the data and conducting field measurements.

We are also thankful to

***Smt. Rameshwari Bhoi, Asst. Professor - Department of Political Science***

***Dr. Lichita Patro, Asst. Professor - Department of Botany***

***Mr. C. P. Ranjan, Asst. Professor - Department of Political Science***

Last but not the least, we would like to thank ***Dr. Bijaya Kumar Behera - Principal***, for giving us an opportunity to evaluate the environmental performance of the campus.

# DISCLAIMER

EHS Alliance Services Energy Audit Team has prepared this Energy Audit Report for Government Autonomous College based on input data submitted by the representatives of college complemented with the best judgment capacity of the expert team.

While all reasonable care has been taken in its preparation, details contained in this report have been compiled in good faith based on information gathered.

It is further informed that the conclusions are arrived following best estimates and no representation, warranty or undertaking, express or implied is made and no responsibility is accepted by Audit Team in this report or for any direct or consequential loss arising from any use of the information, statements or forecasts in the report.

If you wish to distribute copies of this report external to your organization, then all pages must be included.

EHS Alliance, its staff and agents shall keep confidential all information relating to your organization and shall not disclose any such information to any third party, except that in the public domain or required by law or relevant accreditation bodies. EHS Alliance staff, agents and accreditation bodies have signed individual confidentiality undertakings and will only receive confidential information on a 'need to know' basis.



**Vijay Singh**  
Lead Auditor EMS & Energy



**Dr. Uday Pratap**  
Co-Auditor EMS & Energy

# ABBREVIATION

<b>A</b>	<b>Amps</b>
<b>AC</b>	<b>Air Conditioner</b>
<b>AC</b>	<b>Alternating Current</b>
<b>AMET</b>	<b>Academy of Maritime Education and Training</b>
<b>CFL</b>	<b>Compact fluorescent lamp</b>
<b>CIP</b>	<b>Comprehensive Inspection Programme</b>
<b>DC</b>	<b>Direct Current</b>
<b>HSD</b>	<b>High Speed Diesel</b>
<b>Hz</b>	<b>Hertz</b>
<b>kg</b>	<b>Kilogram</b>
<b>kVA</b>	<b>kilo-volt-ampere</b>
<b>kW</b>	<b>kilo Watts</b>
<b>kWh</b>	<b>kilowatt hour</b>
<b>kWp</b>	<b>Kilowatt peak</b>
<b>LED</b>	<b>Light Emitting Diode</b>
<b>LPG</b>	<b>Liquefied Petroleum Gas</b>
<b>MMS</b>	<b>Module mounting structure</b>
<b>MPPT</b>	<b>Maximum Power Point Tracker</b>
<b>NAAC</b>	<b>The National Assessment and Accreditation Council</b>
<b>SEC</b>	<b>Specific Energy Consumption</b>
<b>SPV</b>	<b>Solar Photovoltaic</b>
<b>STC</b>	<b>Standard Test Condition</b>
<b>TV</b>	<b>Television</b>
<b>V</b>	<b>Volts</b>
<b>W</b>	<b>Watts</b>
<b>W/m<sup>2</sup></b>	<b>watt per square metre</b>

# OVERVIEW OF THE COLLEGE

The College started as Rourkela Science College from 16th August, 1961 and was taken over by Government Odisha on 01-07-1963. With the vertical academic growth of the College was conferred with autonomous status in 2002. In the year 2002 the College was accredited by NACC with Grade-B. The College offer variety of Courses at different levels. Besides Art, Science and Commerce at Higher Secondary and Degree levels the College also offers Master Degree in 17 subjects and M. Phil in 03 subjects i.e. Botany, English and Odia. M. Sc in Computer Science, Master in Commerce, Degree Courses in Computer Science, Electronics and Tele-Communication (ETC), Mathematics with Computer (MTC), PGDCA, PGDCH come under Self-finance courses. The College also offers various Degree and P. G. level Courses under Odisha State Open University. The College has been also provided separate Rooms for IGNOU Study Centre. As per the Circular of the Department of Higher Education Government of Odisha the College now stands Bi-furcated in to the Government Autonomous College, Rourkela with effect from Academic Session 2001-2002. Ironically the number of staff both teaching and non-teaching have gone-down after it was Autonomous. There by the Classes are engaged by Guest faculty who are engaged time to time.

The College has not received any UGC grant for last three years. Remuneration for non-teaching is paid from the fee collected from the students, as there is no special grant for the Government for this purpose. This has been a hindrance in achieving our mission of academic excellence to make this premier Institute , a centre of quality learning by training the students to be creative and competitive enough to face the challenges of the new millennium.





# MISSION & VISION

## MISSION


To achieve Academic Excellence by giving impetus and adapting to measures for Enhancing Effective Quality Sustenance and Progression on all key facets of Education. Providing a Dynamic and Conducive Environment for all in order to Inculcate, Infuse, Imbibe, Equip and Disseminate Value Oriented Learning, Creativity, Innovation, Societal Consciousness to achieve Sustainable Livelihood.

## VISION

To achieve Academic Excellence by giving impetus and adapting to measures for Enhancing Effective Quality Sustenance and Progression on all key facets of Education. Providing a Dynamic and Conducive Environment for all in order to Inculcate, Infuse, Imbibe, Equip and Disseminate Value Oriented Learning, Creativity, Innovation, Societal Consciousness to achieve Sustainable Livelihood.

### Geo Location

Geo Coordinates from Google maps:  
22.2263719, 84.8062211

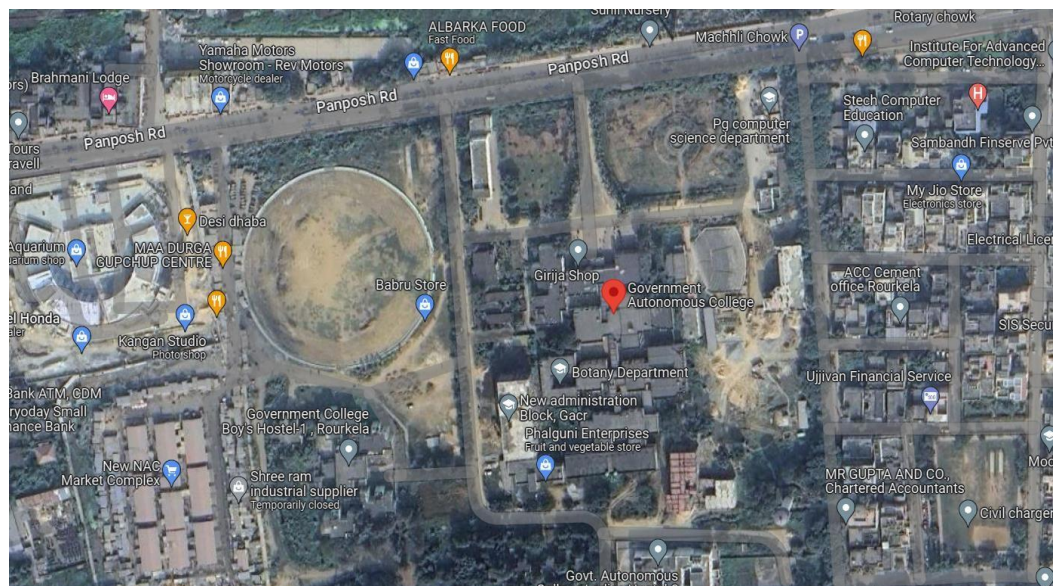



# AUDIT PARTICIPANTS

On behalf of College

Name	Designation
<b>Dr. Bijaya Kumar Behera</b>	<i>Principal</i>
<b>Smt. Rameshwari Bhoi</b>	<i>Asst. Professor - Department of Political Science</i>
<b>Mr. Choudhury Pardosh Ranjan</b>	<i>Asst. Professor - Department of Political Science ( IQAC Coordinator)</i>
<b>Dr. Smruti Snigdha Mishra</b>	<i>Asst. Professor - Department of Chemistry</i>
<b>Mr. Sameer Saurava Prusty</b>	<i>Asst. Professor - Department of Zoology</i>
<b>Dr. Pratap Kumar Swain</b>	<i>Asst. Professor - Department of Chemistry</i>
<b>Dr. Bishwanath Parija</b>	<i>Asst. Professor - Department of Physics</i>
<b>Dr. Parbhudutta Mohanty</b>	<i>Asst. Professor - Department of Computer Science</i>
<b>Dr. Niranjana Sahu</b>	<i>Asst. Professor - Department of Physics</i>
<b>Dr. Lichita Patro</b>	<i>Asst. Professor - Department of Botany</i>
<b>Mr. Prashant Kumar Sethi</b>	<i>Asst. Professor - Department of Botany</i>
<b>Dr. Abeg Jaiswal</b>	<i>Asst. Professor - Department of Statistics</i>
<b>Mr. C. P. Ranjan</b>	<i>Asst. Professor - Department of Political Science</i>
<b>Dr. Sasmita Sasmal</b>	<i>Asst. Professor - Department of Chemistry</i>
<b>Ms. Usharani Sethi</b>	<i>Asst. Professor - Department of Commerce</i>

On behalf of EHS Alliance Services

Name	Position	Qualifications
<b>Mr. Vijay Singh</b>	Lead Auditor	<i>M.Sc. M. Tech (Environment Science &amp; Engineering), Energy Auditor, Post Diploma in Industrial Safety Management</i>
<b>Dr. Uday Pratap</b>	Co-Auditor	<i>Ph.D., EMS: Lead Auditor ISO14001:2015, QCI-WASH</i>



# EXECUTIVE SUMMARY

The purpose of this Energy Audit was to seek opportunities to improve the energy efficiency of the Government Autonomous College. Reducing the energy consumption despite improving the human comfort, health and safety were of primary concern.

Beyond just identifying the energy consumption pattern, this audit sought to detect and categorize the most energy efficient appliances. Additionally, some daily practices relating common appliances have been shared which may help reducing the energy consumption. Data collection for energy audit of the campus was carried out by the EHS Alliance Team. The Energy Audit Report accounts for the energy consumption patterns of the institution on actual survey and detailed analysis during the audit.

The work comprehends the area wise consumption traced using suitable equipment. The analysis was carried out by our team with the support of the staff members from Government Autonomous College. The report provides a list of possible actions to preserve and efficiently access the available source, resources and their saving potential was also identified. We look forward towards optimization that the authorities, students and staff members would follow the recommendations in the best possible way. The report is based on certain generalizations including the approximations wherever necessary. The views conveyed may not reveal the general opinion. They merely represent the opinion of the team guided by the interviews of clients. We are happy to submit this Energy audit report to the Government Autonomous College.

## ENERGY AUDIT – ANALYSIS

### 1. ENERGY CONSUMPTION

To understand the Energy Consumption trends and for analyzing the average monthly consumption we have collected electricity energy bills from July 2021 to June 2022


The details of “**Meter Connection**” at “**Government Autonomous College**” are as follows-


Name	CA No.
PG Department of Odia	814001120164
Principal Govt. College	814001080004
Principal Govt. College	814001080003
PG Department of Computer Science	814001120166

### 1.1 Summary of Monthly Electricity Consumption and Total Bill Amount

To understand the Energy consumption trend and for developing the baseline parameter we have collected monthly energy bill for the 12 months i.e. from July 2021 to June 2022

Month	Grid Electricity Consumption (kWh)	Rate INR	Amount in INR
Jul-21	18753.09	6.20	1,16,269
Aug-21	21063.20	6.20	1,30,592
Sep-21	11160.84	6.20	69,197
Oct-21	13465.99	6.20	83,489
Nov-21	26720.70	6.20	1,65,668
Dec-21	25142.90	6.20	1,55,886
Jan-22	18611.36	6.20	1,15,390
Feb-22	20601.12	6.20	1,27,727
Mar-22	20242.00	6.20	1,25,500
Apr-22	23554.90	6.20	1,46,040
May-22	19900.86	6.20	1,23,385
Jun-22	15508.19	6.20	96,151
<b>Total</b>	<b>234725.15</b>		<b>1455296</b>

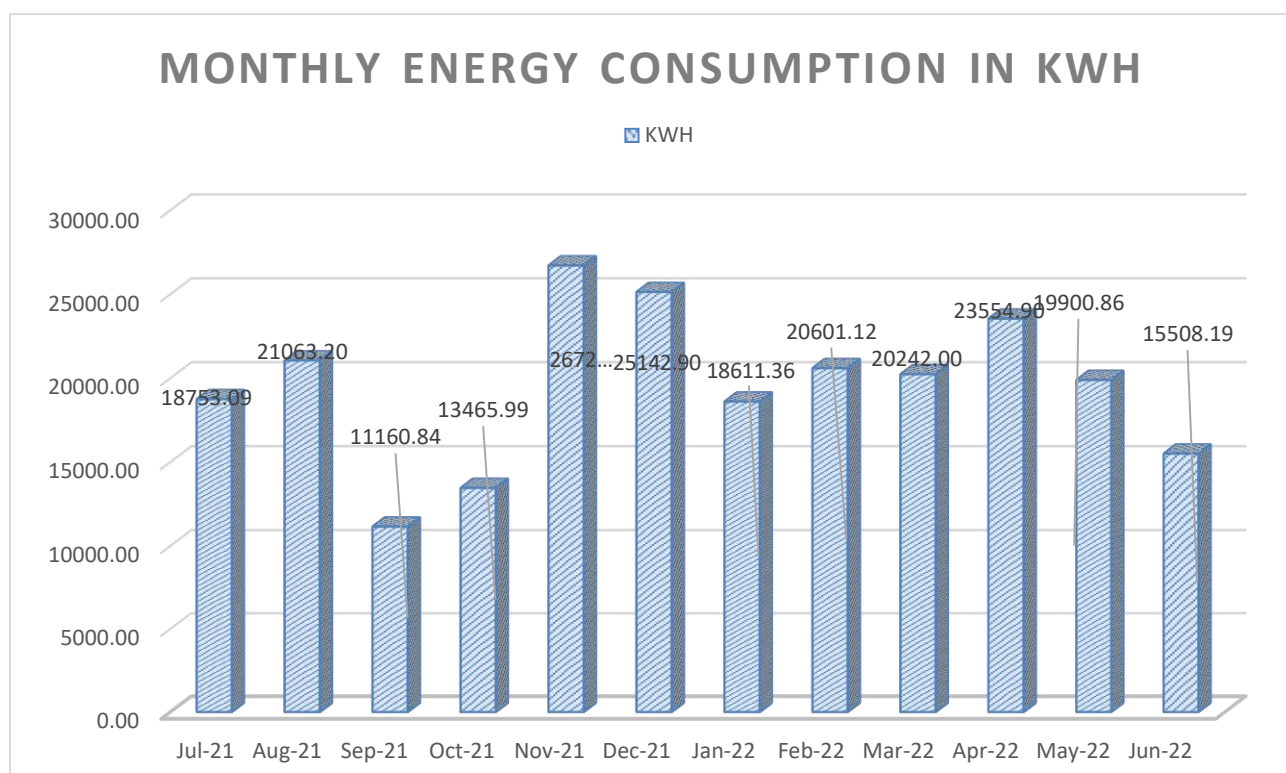

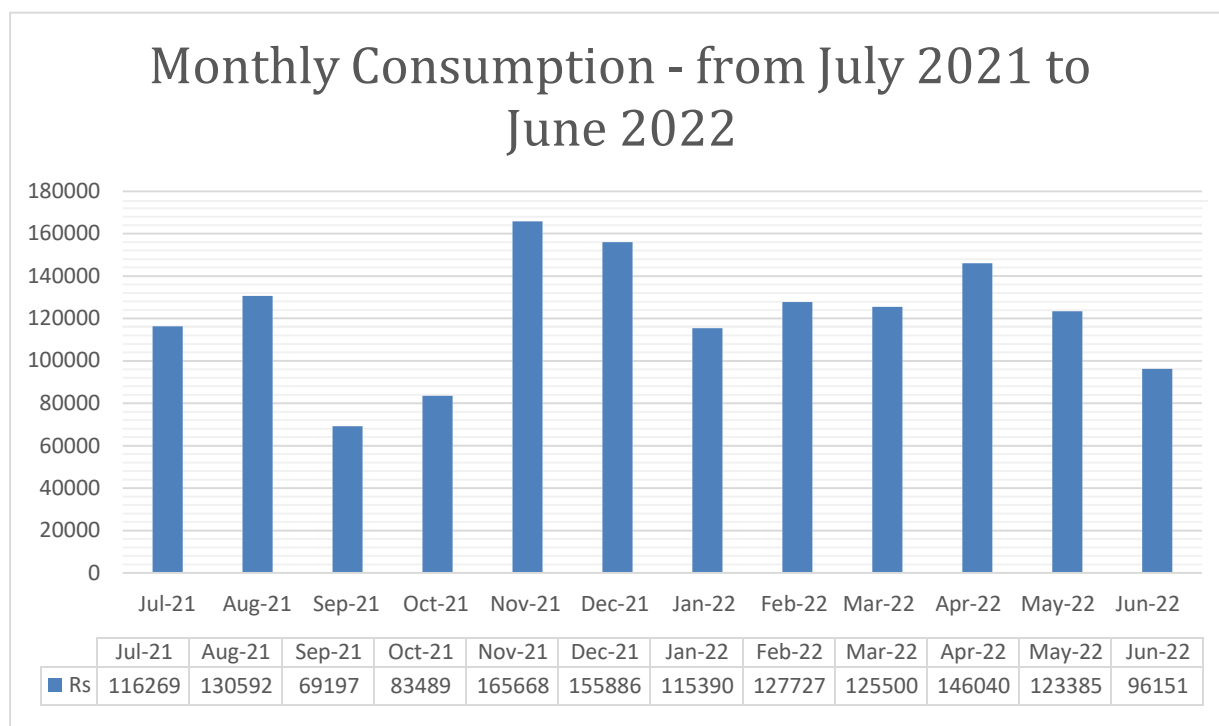

## 2. DIESEL CONSUMPTION

Below is the diesel consumption details in litres from July 2021 to June 2022.

Period	Diesel consumption (in litres)
Jul-21	20
Aug-21	35
Sep-21	10
Oct-21	10
Nov-21	10
Dec-21	10
Jan-22	15
Feb-22	10
Mar-22	20
Apr-22	35
May-22	0
Jun-22	0
<b>Total</b>	<b>175</b>

### 3. ANALYSIS OF DG SETS

In the campus, there is only one Diesel Generator (DG) set for its electrical power needs in case of Grid power failure. DG sets capacity is 125 kVA.

DG Set Performance			
Description	Unit	DG Station -1	DG Station -2
Design details:			
Rated capacity	kVA	62.5 KVA (3Phase)	62.5 KVA (3Phase)
Hz		50	50
Sl No.		N4F18TC-06876	N4H18TC-07080
Make		Mahendra & Mahendra	Mahendra & Mahendra
Volts	Volts	415	415
PF		0.8	0.8
Phase		3	3
RPM		1500	1500
Amps	Amps	87	87
Mfg.		2018	2018

DG Set Operation details		
Operating hours during testing	Hours	0.50
% Loading	%	63.72
Energy Generation	kWh	34.23
Load	kVA	92.73
Fuel consumption during testing	Litre	8
Specific energy generation	kWh/litre	3.18

#### Observation and Suggestions:-

Soundproof silent generators are an efficient tool to keep both noise and vibration at low levels. For the power backup of the institution, the soundproof model is installed near herbal garden of the institution.

As per the trial taken during the energy audit the percentage loading of DG set is 63.72% which is ok and specific energy consumption of DG Sets 3.18 kWh/Litre which is satisfactory because as per manufacturer recommendation, best practices for SEC in DG sets range from 3.0 to 3.5 kWh/Litre and above.

We recommend college to initiate periodic maintenance schedule and stack monitoring of DG set through authorized lab.





## 4. AC SYSTEM

*Energy Efficiency Ratio (EER):* Performance of smaller chillers and rooftop units is frequently measured in EER rather than kW/ton. EER is calculated by dividing a chiller's cooling

Capacity (in Btu/h) by its power input (in watts) at full-load conditions. The higher the EER, the More efficient the unit. The cooling effect produced is quantified as tons of refrigeration (TR). The above TR is also called as air-conditioning tonnage.

There are Split ACs installed in Government Autonomous College in various areas of various capacity which detail is given below:-

**GOVERNMENT AUTONOMOUS COLLEGE | ENERGY AUDIT REPORT**

Sl No.	Location/Identification	Type (Window - w/Split - S)	Quantity	AC TR	Room Temp. (°C)	AC-Tout (°C)	AC-Tin (°C)	Room-RH (%)	Area (m2)	Air velocity (m/s)	Enthalpy Hout	Enthalpy Hin	Heat Load in TR	KW supplied	(Eff.) Power per Ton	EER
1	Commerce	S	1	1.5	24	11	20	52	0	2	22	38	0.4	0.6	1.6	2.2
2	Mathematics	S	2	1.5	24	12	20	52	0	2	25	38	0.3	0.6	1.7	2
3	Statistics	S	1	1.5	24	11	19	52	0	3	24	37	0.4	0.6	1.5	2.3
4	Computer Science	S	2	1.5	24	10	18	52	0	2	24	37	0.4	0.5	1.5	2.3
5	Computer Science	S	7	2.0	23	12	20	52	0	2	25	38	0.3	0.6	1.7	2.1
6	Computer Science	W	3	1.5	23	11	19	52	0	2	22	37	0.3	0.6	1.7	2
7	Chemistry	S	1	2.0	23	13	20	52	0	2	26	38	0.3	0.5	1.7	2
8	Physics	W	6	1.5	23	12	20	52	0	2	25	38	0.3	0.6	1.7	2
9	Hindi	S	2	1.5	23	12	19	52	0	2	24	37	0.3	0.6	1.7	2
10	English	S	2	1.5	24	11	20	52	0	2	22	38	0.4	0.7	1.7	2.1
11	Economics	S	1	1.5	24	12	20	53	0	3	25	38	0.3	0.6	1.8	2
12	Political Sciencee	S	1	1.5	24	12	20	53	0	2	25	38	0.3	0.6	1.8	2
13	Odia	S	6	1.5	23	12	20	52	0	3	25	38	0.3	0.6	1.9	1.9
14	Autonomous 1st Floor	S	5	1.5	23	13	20	52	0	3	26	38	0.3	0.6	1.9	1.9
15	Autonomous Ground Floor	S	4	1.5	23	12	20	52	0	3	25	38	0.3	0.6	1.9	1.9
16	Autonomous Ground Floor	S	1	2.0	23	11	19	53	0	2	22	38	0.4	0.8	2	1.7
17	Office	S	9	1.5	22	12	22	52	0	2	23	43	0.4	0.8	1.8	2
18	SAMS	S	1	1.5	23	11	21	52	0	2	24	40	0.4	0.7	1.8	2
19	Library	S	1	1.5	22	10	19	52	0	2	20	37	0.4	0.8	2	1.8
20	Bosy'S Hostel-1	S	8	1.5	24	11	20	52	0	2	22	38	0.4	0.6	1.6	2.2
21	Boys Hostel-2	S	7	2.0	24	12	20	52	0	2	25	38	0.3	0.6	1.7	2
22	Boys Hostel-3	W	3	2.0	24	11	19	52	0	3	24	37	0.4	0.6	1.5	2.3
23	Girl's Hostel-1	S	7	1.5	24	10	18	52	0	2	24	37	0.4	0.5	1.5	2.3
24	Girl's Hostel-2	S	1	2.0	23	12	20	52	0	2	25	38	0.3	0.6	1.7	2.1
25	Girl's Hostel-3	S	8	1.5	23	11	19	52	0	2	22	37	0.3	0.6	1.7	2
26	Quarter	S	12	1.5	23	13	20	52	0	2	26	38	0.3	0.5	1.7	2

Remarks: - We have checked Energy Efficiency Ratio of AC's and EER of AC's is fairly OK. But in future you should purchase 5-Star rated inverter based split AC's because power consumption of Inverter based BEE 5-Star rated AC's is less than non-star rated AC's.

Also, we recommend Government Autonomous College to organize periodic maintenance schedule and take corrective actions for insulating of AC's refrigerant lines in order to protect energy losses.



## 5. FANS ANALYSIS

In the Government Autonomous College, there are 831 fans installed, Out of which 302 ceiling fans are of 50 W, 218 Ceiling fans are of 60W and 305 ceiling fans are of 70W and 6 fans are pedestal fans (60W). The observation and suggestion are given below.

Sl No.	Location/ Identification	Ceiling Fan-50W	Ceiling Fan-60W	Ceiling Fan-70W	Pedestal Fan 60W
1	History	4			
2	Commerce	30			
3	Mathematics	16			
4	Statistics	8			3
5	Zoology			33	
6	Botany			38	
7	Education	6			
8	Computer Science			29	
9	ETC	3			
10	Psychology	10			
11	Chemistry			16	
12	Physics			20	
13	Hindi		60		
14	English			12	
15	Economics			2	
16	Political Science			2	
17	Odia		31		
18	Sociology			4	
19	Logic & Philosophy			2	
20	Autonomous 1st Floor		7		
21	Autonomous Ground Floor		6		
22	Office		10		1
23	SAMS		1		
24	Library		12		
25	Boy's Hostel-1	93			
26	Boys Hostel-2		25		
27	Boys Hostel-3		25		
28	Girl's Hostel-1			58	
29	Girl's Hostel-2			70	
30	Girl's Hostel-3	132			2
31	Quarter		41	19	
	<b>TOTAL</b>	<b>302</b>	<b>218</b>	<b>305</b>	<b>6</b>

### Observation and Suggestions:-

In the college, mostly ceiling fans are of 60 W and 70W but BEE 5 Star Rated of 30W Ceiling Fans are present in the market. We recommend to replace to BEE 5 Star rated 30W fans.

Note:- Energy saving will increase or decrease if operating hours of machine /equipment will be increased or decreased and payback period will also increase or decrease if cost of investment will increase or decrease because cost of investment is taken on tentative basis.

## 6. ANALYSIS OF LIGHTING SYSTEM

### 6.1 Brief description of existing system

For assessing energy efficiency of lighting system, Inventory of the Lighting System has been noted / collected, with the aid of a lux meter, measurement and documentation of the lux levels at various locations at working level has been done.

### 6.2 Inventory of Lighting

Sl. No.	Location/ Identification	200W -LED High Mast	10 W LED	18W LED Light	12 W LED Round	36 W LED	36W Tube light	18W LED Flood	20 W LED
1	History			7					
2	Commerce			21					
3	Mathematics			26					
4	Statistics			8					
5	Zoology			30					
6	Botany			58					
7	Education			6					
8	Computer Science			80					
9	ETC			6					
10	Psychology			9					
11	Chemistry			48					
12	Physics			42					
13	Hindi								
14	English			32		5			
15	Economics			3					
16	Political Science			2					
17	Odia			30					
18	Sociology			4					
19	Logic & Philosophy			2					
20	Autonomous 1st Floor			10					
21	Autonomous Ground Floor			10					
22	Office			29					
23	SAMS			4					
24	Library			24					
25	Boy'S Hostel-1	7	251						56
26	Boys Hostel-2	2	9						51
27	Boys Hostel-3	3	15	26					92
28	Girl's Hostel-1		43						63
29	Girl's Hostel-2		50						
30	Girl's Hostel-3		343				195		
31	Quarter		106	22	28				
	<b>TOTAL</b>	<b>12</b>	<b>817</b>	<b>539</b>	<b>28</b>	<b>5</b>	<b>195</b>	<b>0</b>	<b>262</b>



### 6.3 Lux Measurement

Description	Lux	Remark
<b>Class Rooms</b>	120 to 235	Acceptable
<b>Offices</b>	130 to 240	Acceptable
<b>Corridors</b>	35 to 90	Acceptable
<b>Washrooms</b>	45 to 76	Acceptable
<b>Outdoor</b>	36 to 95	Acceptable
<b>Computer Lab</b>	150 to 289	Acceptable
<b>Parking area</b>	45 to 94	Acceptable
<b>Canteen</b>	69 to 185	Acceptable

### Observation

College has initiated LED based lighting solution, but still there are 195 (36W) tube lights. LEDs save energy, the life span is much greater and emit virtually no heat. We recommend to replace the tube lights with LEDs.

Additionally, we recommend to install motion sensor-based lights in common areas such as library, washrooms, corridors, etc.

We also recommend to use solar lights for open areas like parking, ground, street lights, etc. Table below shows the performance characteristics comparison of all luminaries.

Table - Luminous Performance Characteristics of Commonly Used Luminaries					
Type of Lamp	Lumens/Watt		Colour Rendering Index	Typical Application	Typical Life
	Range	Avg.			
<b>Incandescent</b>	8-18	14	Excellent (100)	Homes, restaurants, general lighting emergency lighting	1000
<b>Fluorescent lamps</b>	46-60	50	Good w.r.t coating (67-77)	Offices, shops, hospitals, homes	5000
<b>Compact fluorescent Lamps (CFL)</b>	40-70	60	Very Good (85)	Hotels, shops, homes, offices	8000-10000
<b>High pressure mercury (HPMV)</b>	44-57	50	Fair (45)	General lighting in factories, garages, car parking. flood lighting	5000
<b>Halogen lamps</b>	18-24	22	Excellent (100)	Display, flood lightening, stadium exhibition grounds, construction areas	2000 - 4000
<b>High pressure sodium (HPSV) SON</b>	67-121	90	Fair (22)	General lighting in ware houses, factories, street lighting	6000 - 12000
<b>Low pressure sodium (LPSV) SOX</b>	101-175	150	Poor (10)	Roadways, tunnels, canals, street lighting	6000 - 12000
<b>Metal halide lamps</b>	75-125	100	Good (70)	Industrial bays, spot lighting, flood lighting, retail stores	8000
<b>LED Lamps</b>	30-50	40	Good (70)	Reading lights, desk lamps, night lights, spotlights, security lights, signage lights, etc.	40000 - 100000

## 7. OTHER POWER CONSUMPTION

### 7.1 Inventory of IT Infrastructure

Sl No.	Location/ Identification	Desktop	Laptop	Printers	Scanners	Servers
1	History	0	1	1	1	
2	Commerce		1	1	1	
3	Mathematics	32	1	1	1	
4	Statistics	1	1	1	1	
5	Zoology	2	1	1	1	
6	Botany	1	1	1	1	
7	Education		1	1	1	
8	Computer Science	71	1	2	2	
9	ETC	10	1	1	1	
10	Psychology	1	1	1	1	
11	Chemistry	1	1	1	1	
12	Physics	3	1	2	2	
13	Hindi		1	1	1	
14	English	4	1	1	1	
15	Economics		1	1	1	
16	Political Sciencee		1	1	1	
17	Odia	3	1	1	1	
18	Sociology		1	1	1	
19	Logic 7 Philosophy		1	1	1	
20	Autonomous 1st Floor	4		3	3	
21	Autonomous Ground Floor	6		5	5	1
22	Office	8		4	4	1
23	SAMS	3		1	1	1
24	Library	3		1	1	
25	Boys Hostel-1	1		1	1	
26	Boys Hostel-2	1		1	1	
27	Boys Hostel-3	1		1	1	
28	Girl's Hostel-1	1		1	1	
29	Girl's Hostel-2	1		1	1	
30	Girl's Hostel-3	1		1	1	
	<b>TOTAL</b>	<b>159</b>	<b>19</b>	<b>41</b>	<b>41</b>	<b>3</b>

## 7.2 Water pump details

Description	Rated Power of Motor	Motor Eff.	Discharge Head	Suction Head	Pump Type
<i>Unit</i>	<i>KW</i>	<i>%</i>	<i>m</i>	<i>m</i>	<i>Submersible/ Monoblok/ Centrifugal Etc.</i>
Pump No.-1	1.5	2	4	3	Submersible
Pump No.-2	2		29	43	Submersible
Pump No.-3	2		29	43	Submersible
Pump No.-4	0.75		29	49	Submersible
Pump No.-5	1.5	2	4	3	Submersible
Pump No.-6	2		29	43	Submersible
Pump No.-7	2		29	43	Submersible
Pump No.-8	1.5	2	4	3	Monoblock
Pump No.-9	0.75		29	49	Submersible
Pump No.-10	5		15	20	Monoblock

## 7.3 Exhaust fan details

Sl No.	Location/Identification	60W Exhaust Fan	160W Exhaust Fan	Water Cooler-200W
1	History			2
2	Commerce			
3	Mathematics			
4	Statistics			
5	Zoology			2
6	Botany	3		
7	Education			
8	Computer Science	1		
9	Psychology			
10	Chemistry	12		
11	Physics	2		
12	Hindi			
13	English			
14	Economics			
15	Political Sciencee			
16	Odia	2		
17	Sociology			
18	Logic & Philosophy			
19	Autonomous 1st Floor	1		
20	Autonomous Ground Floor	1		
21	Office	4		
22	SAMS			
23	Library	4		
24	Bosy'S Hostel-1	1	1	1
25	Boys Hostel-2	3		
26	Boys Hostel-3	6	1	
27	Girl's Hostel-1		3	
28	Girl's Hostel-2	1		
29	Girl's Hostel-3	14		
30	Quarter	21		11
	<b>TOTAL</b>	<b>76</b>	<b>5</b>	<b>16</b>

## ANALYSIS

There should be regular maintenance schedule of equipment like pumps, exhaust fans and IT equipment. Electronics such as computers, printers, scanners, etc. more than 3 year or 5 years (as per their life) should be replaced with new computers/laptops. Ideal Temperature should be maintained for all electronic appliances.

\*\*\*\*\* **END OF THE REPORT** \*\*\*\*\*